


UC SAN DIEGO HEALTH HILLCREST MEDICAL CENTER REDEVELOPMENT PROJECT

200 WEST ARBOR DR.

1

THE COPYRIGHTS TO ALL RECORDS AND DRAWINGS ARE THE PROPERTY OF LATITUDE 33. REPRODUCTION OR USE FOR ANY PURPOSE OTHER THAN THAT AUTHORIZED BY LATITUDE 33 IS FORBIDDEN.

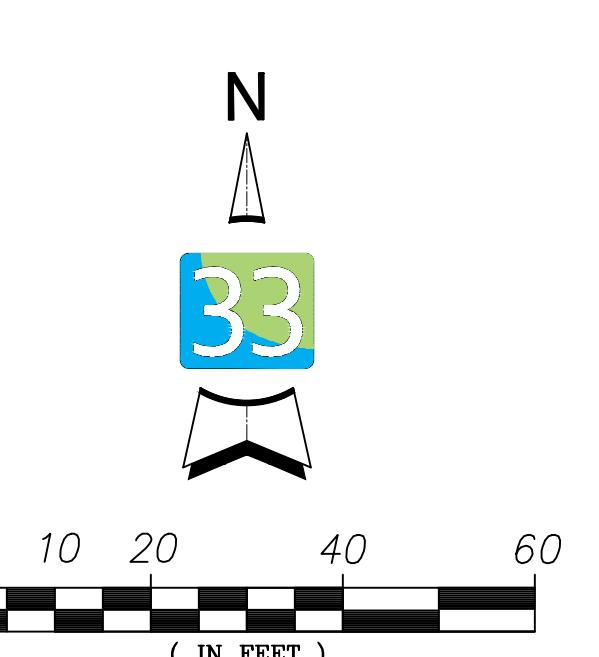

0 10 20 30 40 50 60
(IN FEET)
1 inch = 20 ft


N
33

E

1

LEGEND

PROPOSED ELECTRIC	
PROPOSED SEWER	
PROPOSED DOMESTIC WATER	
PROPOSED TELECOM	
PROPOSED STORM DRAIN	
PROPOSED FIRE WATER	
PROPOSED CHILLED WATER SUPPLY & RETURN PIPES	
PROPOSED HOT WATER SUPPLY & RETURN PIPES	
PROPOSED SOFT WATER	
PROPOSED STORM DRAIN STRUCTURE	
PROPOSED FIRE WATER TANK	
SEWER STRUCTURE	
PROPOSED FUEL OIL TANK	
PROPOSED FIRE HYDRANT	

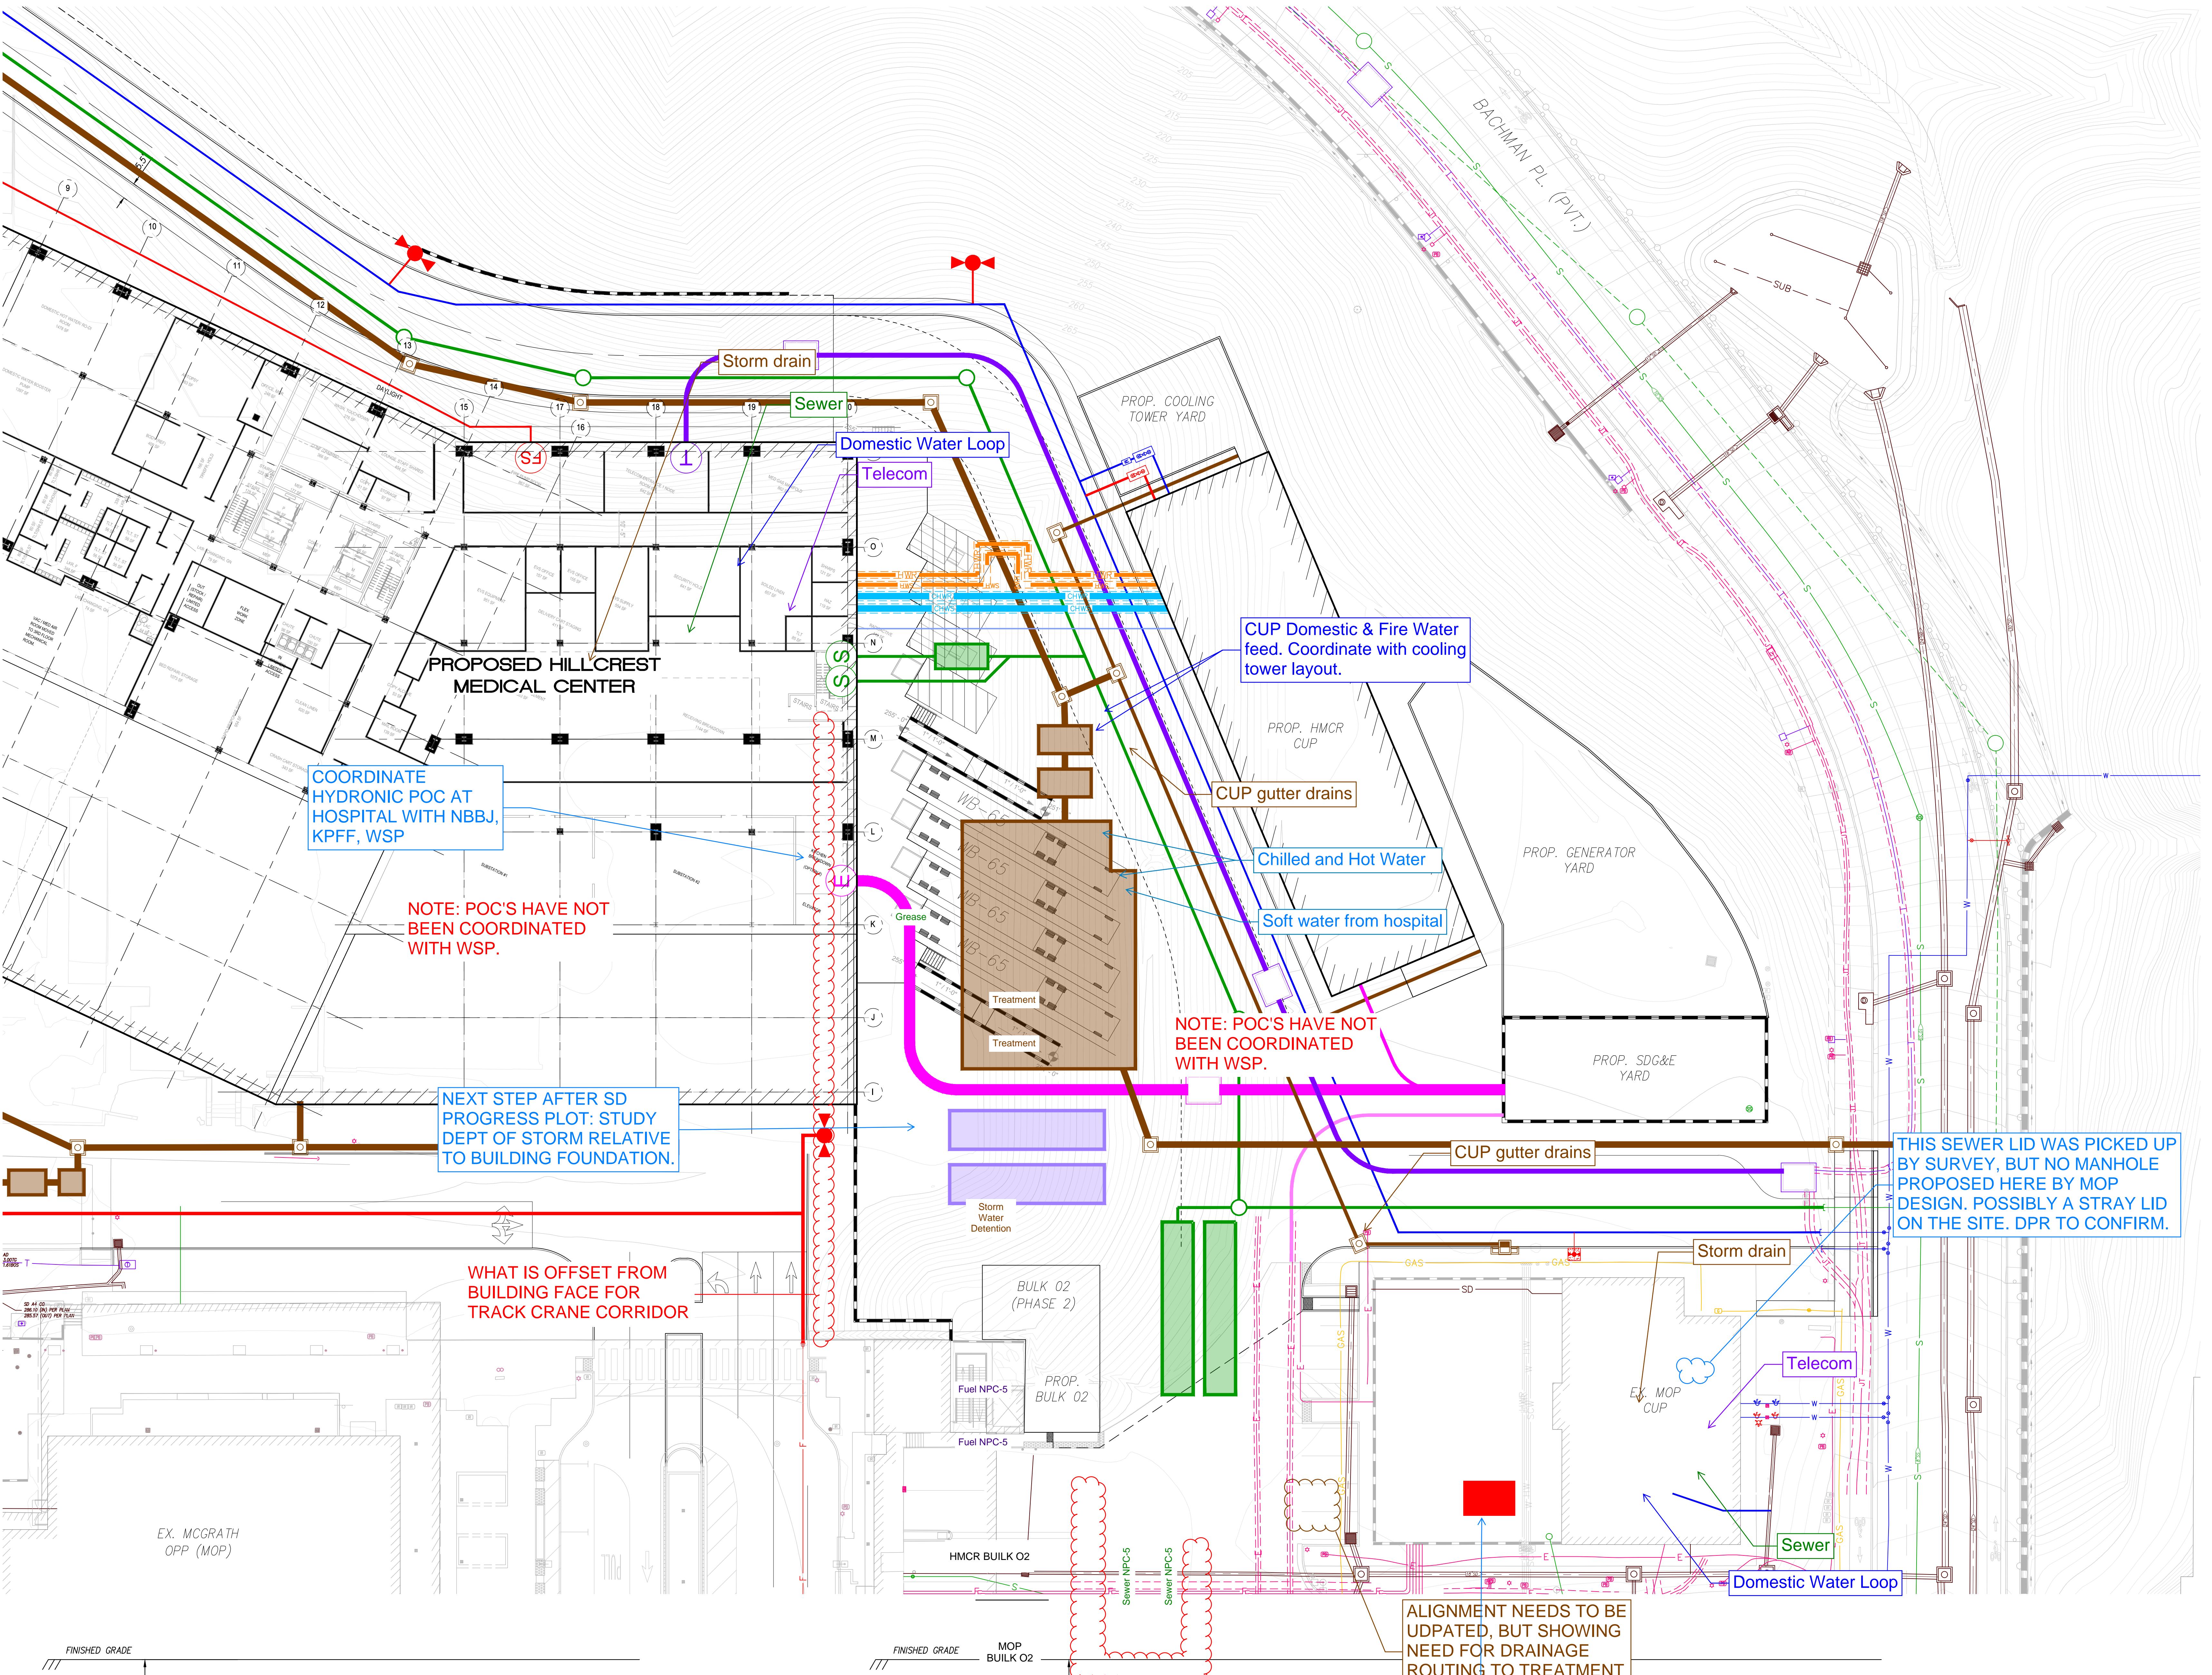

ASSUMED TELECOM AND ELECTRIC JOINT TRENCH CROSS SECTION

NTS

SHORING REQUIRED - NEEDS
FURTHER DISCUSSION/
COORDINATION.

L33 BELIEVES THIS IS
PRIVATE ELEC CONDUIT
FROM PARKING
STRUCTURE. CONFIRM
WITH DPR.


ASSUMED TELECOM AND ELECTRIC JOINT TRENCH CROSS SECTION

NTS

ASSUMED HYDRONIC PIPE CROSS SECTION

NTS

PLAN TO DEMO THIS
MECHANICAL VULT -
NEED TO CONFIRM
AND LOG WITH UCSD.

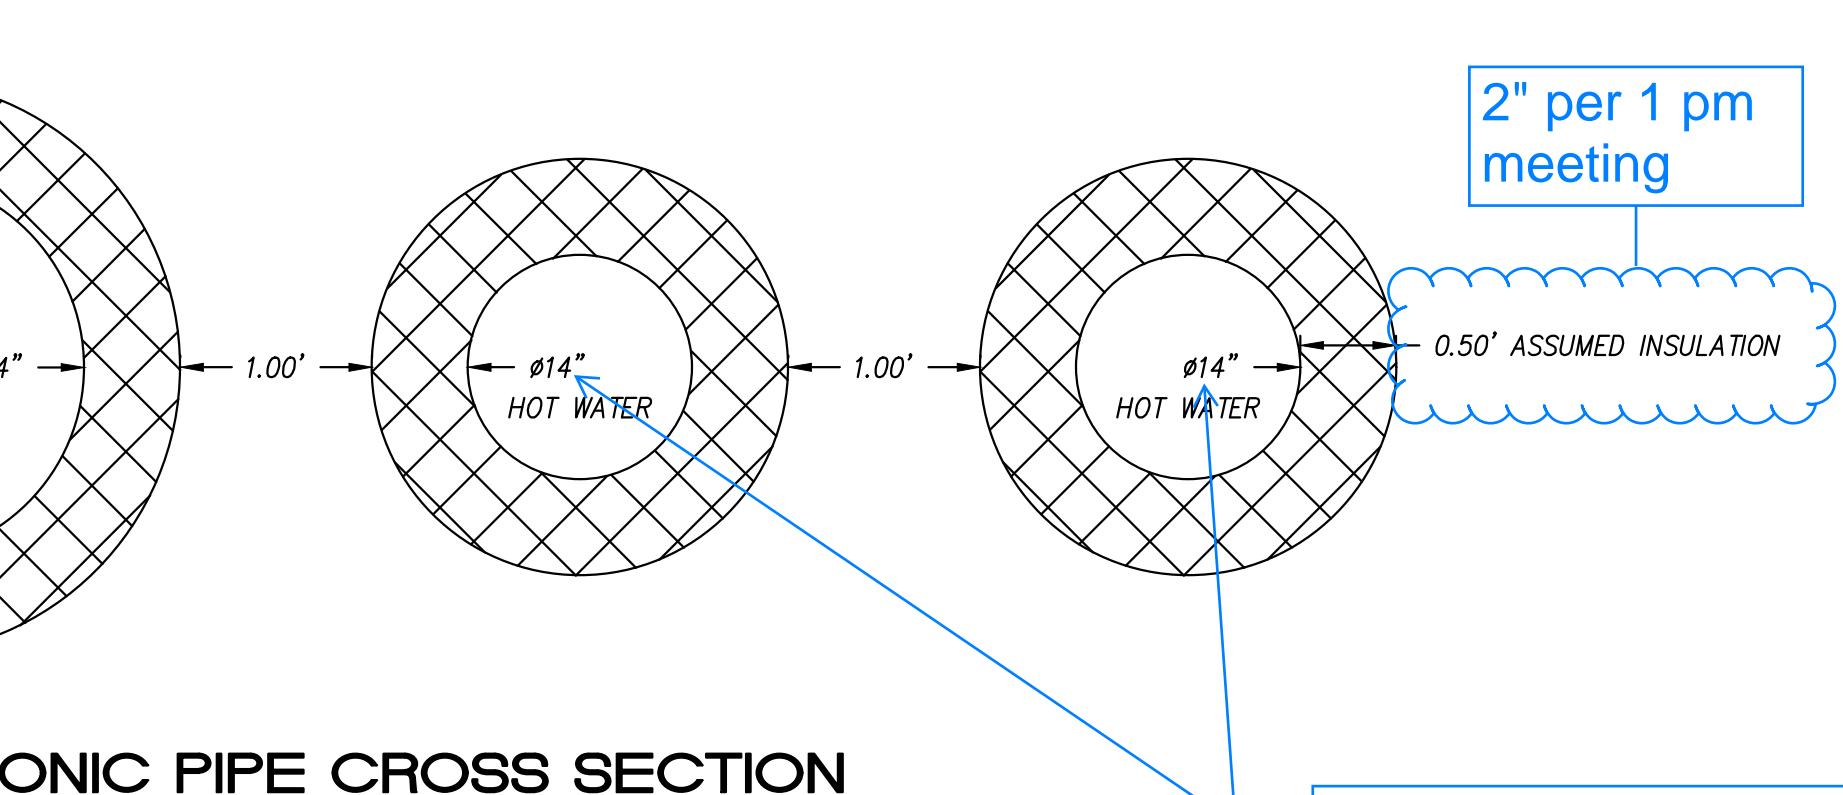

16" per 1 pm meeting

L33 PROJECT # 2000.00
UCSD PROJECT # 5551
DATE: 4/1/08/2006
DRAWN BY: KC
CHECKED BY: RT

EXHIBIT

PROPOSED CUP UTILITY COORDINATION

1